

Viewmax Windows and Doors Co., Ltd.

TEST REPORT

SCOPE OF WORK

S122 Fixed Window

REPORT NUMBER

240701007SHF-001

TEST DATE(S)

2024-07-15

ORIGINAL ISSUE DATE

2024-08-14

PAGES


17

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-101(February 1, 2024)

© 2024 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

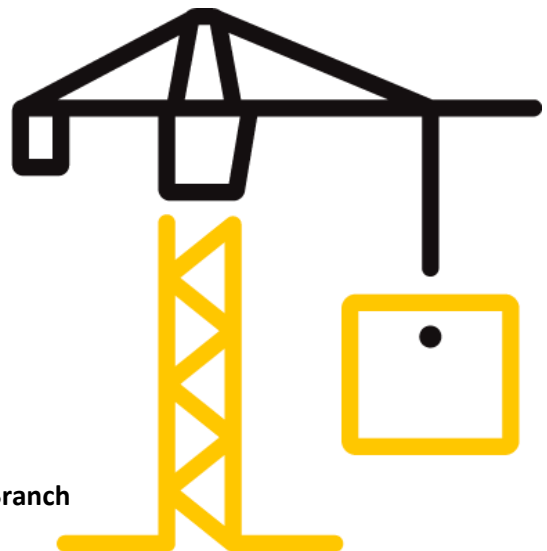

Test Report

Statement

- 1.This report is invalid without company's special seal for testing on the assigned page.
- 2.This report is invalid without an authorized person's signature.
- 3.This report is invalid if altered.
- 4.Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Don't copy this report in partial without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
- 5.This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
- 6.Except for the obligation, responsibility and liability (if any) for the appropriateness and professionalism of afore-mentioned testing itself within the scope and amount of the testing fee received, Intertek does not and will not accept any other obligation or liability.
- 7.If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
- 8.Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
- 9.The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.

Test Report

Original Issue Date: 2024-08-14 Intertek Report No. 240701007SHF-001

Applicant: Viewmax Windows and Doors Co., Ltd.
Applicant Address: No.297, Huaxin Road, Yanggu County, Liaocheng City, Shandong Province
Attn: Lu Houchang
Manufacturer: Viewmax Windows and Doors Co., Ltd.
Manufacturer Address: No.297, Huaxin Road, Yanggu County, Liaocheng City, Shandong Province
Product Type: Fixed Window
Product Model: S122
Primary product designator: Class CW - PG60 - Size Tested 2400 × 1800 mm (94.49 × 70.87 in.) - Type FW
Optional secondary designator: Positive Design Pressure = +2880 Pa (60.15 psf)
Negative Design Pressure = -2880 Pa (60.15 psf)
Water penetration resistance test pressure = 720 Pa (15.04 psf)
For Canada: Canadian Air Infiltration/Exfiltration: Fixed Level
SUBJECT: Performance testing
Fixed Window

Product Information

Product Name	Model	Specification
S122 Fixed Window	S122	2400mm(Width) x 1800mm(Height)
Sample ID	Sample Amount	Sample Received Date
S240701007SHF.001	1 Set	2024-07-01
Brand	Sample Description	
Viewmax	The sample was a completely assembled, glazed, functional product, fitted in the test apparatus in accordance with documented instructions.	

Test Methods And Standards

Test Standard	ASTM E283/E283M-2019; ASTM E547-00(R2016); ASTM E330/E330M-2014(R2021); ASTM F588-17
Specification Standard	AAMA/WDMA/CSA 101/I.S.2/A440-17 (NAFS 2017 - North American Fenestration Standard / Specification for Windows, Doors and Skylights) Clause 9.3.2, Clause 9.3.3, Clause 9.3.4 and Clause 9.3.5; CSA A440S1-19 Canadian Supplement to AAMA/WDMA/CSA 101/I.S.2/A440-17 Clause 5.4 and Clause 5.5
Test Conclusion	The results met AAMA/WDMA/CSA 101/I.S.2/A440-17 and CSA A440S1-19 requirements specified on Fixed Window, and the results were shown in the following page.

Note: 1.This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the testing applicant. Representativeness and authenticity of the submitted samples are responsibilities of the testing applicant.

Report Authorized


Name: Zac Zhang Name: Gio Liu
Title: Reviewer Title: Project Engineer

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Test Items, Method and Results:

1 Test Samples

Sample was submitted to Intertek directly from the client. Sample was not independently selected for testing. Sample was received at the Evaluation Center on July 1, 2024.

A full scale sample of S122 Fixed Window (Model: S122) was provided by the manufacturer that was not weathered nor conditioned.

The description of the samples given below has been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

Table 1 Product Information

Product Name	S122 Fixed Window
Model	S122
Dimension of Window Frame	2440mm(Width) x 1800mm(Height) x 122mm(Thickness)
Dimension of Daylight Opening	2306mm(Width) x 1706mm(Height)
Profile	Aluminum Model: S122 Supplier: Huajian Aluminum Industry Group Co., Ltd.
Frame Corner Construction Details:	45° cutting, corner with pin Angle code connection fixed and glued
Joinery type	
Reinforcement	None
Glazing	Dimension: 2334mm(Width) x 1734mm(Height) Structure: 39mm thickness, 12mm Tempered + 15mm Ar + 12mm Tempered Glass Supplier: Viewmax Co., Ltd.
Hardware	None
Weather-strip	None
Thermal Break	Model: 500299; Material: PA66GF25 Supplier: Xin Gao Co., Ltd.
Drainage	Sizes: 30mm(Width) x 5mm(Height); Quantity: 4
Gasket	Model: 463252, 470714, 470715; Material: EPDM Supplier: Ningbo Conta Sealing Products Co., Ltd.
Sealant	Model: 796 Neutral Silicone Sealant; Material: Silicone Supplier: Dow Corning Ltd.
Installation	The rough opening allowed for a 10mm shim space. The perimeter of the tested specimen was fixed by screws every 300mm and sealed with silicone

The Sample ID was S240701007SHF.001. The drawings of the representative sample were referenced in Appendix A, the test data was referenced in Appendix B and the photo of the representative sample was referenced in Appendix C.

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Test Items, Method and Results:

2 Test Result

Table 2 Test Result

Test Description	Requirements (Class CW-PG60)		Results		Verdict
2024/7/15					
Air Leakage Resistance Test AAMA/WDMA/CSA 101/I.S.2/A440-17, Clause 9.3.2 ASTM E283/E283M-2019	Maximum air leakage at +75 Pa	0.2 L/s·m ²	Air leakage at +75 Pa	0.02 L/s·m ²	Pass
	Maximum air leakage at -75 Pa	0.2 L/s·m ²	Air leakage at -75 Pa	0.04 L/s·m ²	
Water Penetration Resistance Test AAMA/WDMA/CSA 101/I.S.2/A440-17, Clause 9.3.3 ASTM E547-2000 (R2016)	Minimum water pressure	440 Pa	Test Pressure	720 Pa	Pass
			After water sprayed for four cycles in 24 minutes at 720 Pa, no water penetration was observed.		
Uniform Load Deflection Test AAMA/WDMA/CSA 101/I.S.2/A440-17, Clause 9.3.4.2 ASTM E330/E330M-2014 (R2021)	Minimum Design Pressure (DP)	2880 Pa	Design Pressure (DP)	+2880 Pa	Pass
			Maximum deflection at Jamb	0.1 mm	
			Maximum deflection at Glazing	6.9 mm	Reported ¹
			Design Pressure (DP)	-2880 Pa	Pass
			Maximum deflection at Jamb	0.4 mm	
			Maximum deflection at Glazing	6.8 mm	Reported ¹

Note: 1. The deflection of the glazing is recorded for reference only.

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Table 2 Test Result (Continued)

Test Description	Requirements (Class CW-PG60)		Results		Verdict
2024/7/15					
Uniform Load Structural Test AAMA/WDMA/CSA 101/I.S.2/A440-17, Clause 9.3.4.3 ASTM E330/E330M-2014 (R2021)	Minimum Structural Pressure (STP)	4320 Pa	Structural Pressure (STP)	+4320 Pa	Pass
			No significant breakage or damage after ultimate strength was released.		
			Maximum permanent deformation at Jamb	<0.1 mm	
			Maximum permanent deformation at Glazing	<0.1 mm	
			Structural Pressure (STP)	-4320 Pa	
			No significant breakage or damage after ultimate strength was released.		
			Maximum permanent deformation at Jamb	0.1 mm	
			Maximum permanent deformation at Glazing	<0.1 mm	
Forced-entry Resistance Test AAMA/WDMA/CSA 101/I.S.2/A440-17, Clause 9.3.5 ASTM F588-17	Minimum Grade 10		Test Class	Grade 10	Pass
			During the test and upon removal of loads, all locking devices were remained engaged and could not entry.		

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Appendix A: Sample Drawings

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Appendix B: Test Data

B.1 Air Leakage Resistance Test – Test method ASTM E283/E283M-2019

Overall area: 4.32 m²

Table B.1 Test Data of Air Leakage Resistance Test

Infiltration rate (75 Pa)	0.02 L/s·m ²	<0.01 cfm/ft ²
Exfiltration rate (75 Pa)	0.04 L/s·m ²	0.01 cfm/ft ²
Requirements (75 Pa): U.S. (only) maximum allowable leakage for Class CW Windows; Canadian (only) air Infiltration / Exfiltration levels for Class CW Windows: Fixed Level	0.2 L/s·m ²	0.04 cfm/ft ²

The tested specimen met the requirements for Class CW for Air Leakage Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17.

The tested specimen met the requirements for Canadian (only) Air Infiltration / Exfiltration levels for Class CW windows: Fixed level for Air Leakage Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17.

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Appendix B: Test Data

B.2 Water resistance test – Test method ASTM E547-00(R2016)

No water penetration occurred when the pressure was 720 Pa (15.04 psf).

After water sprayed for four cycles in 24 minutes at 720 Pa, no water penetration was observed.

Test result: $P_{\max} = 720 \text{ Pa}$ (15.04 psf).

The tested specimen met the requirements for Class CW-PG60 for Water Penetration Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17.

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Appendix B: Test Data

B.3 Uniform Load Deflection Test – Test method ASTM E330/E330M-2014(R2021), Procedure A

Span length, L = 1720 mm Set Points (1-3)

Span length, L = 1680 mm Set Points (4-6)

Test Pressure (DP), P = 2880 Pa (60.15 psf)

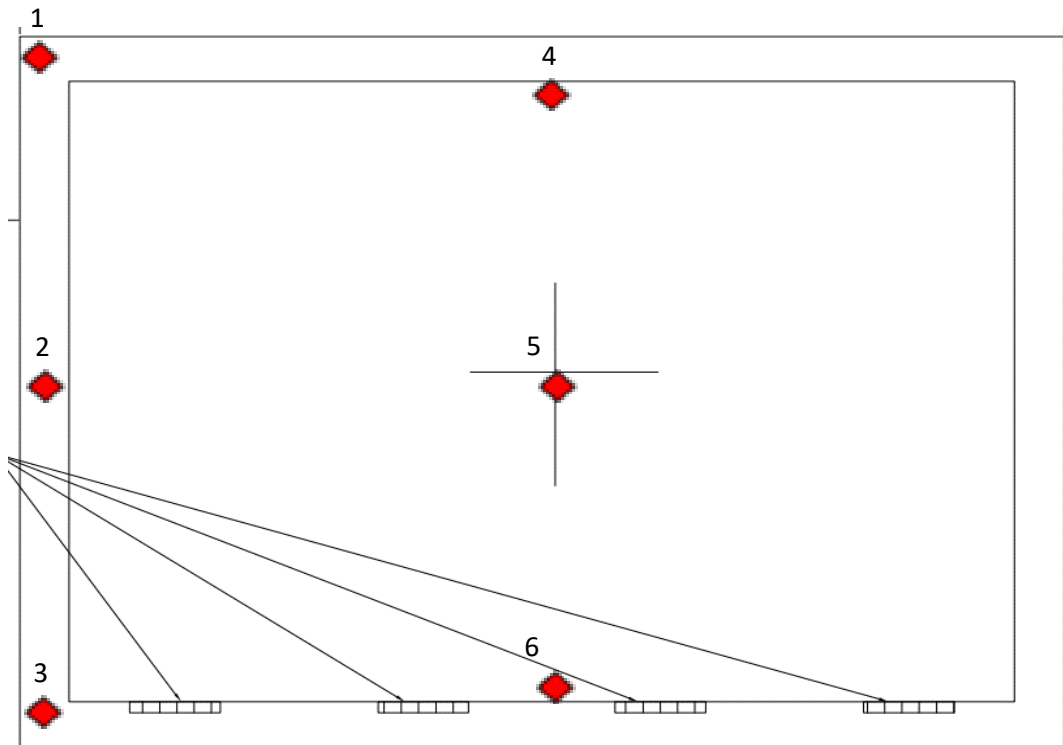


Fig.5 Locations of Displacement Measuring Devices

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Table B.2 Test Data of Uniform Load Deflection Test

Member (mm)		Test Pressure (Pa)	Deflection (mm)			Maximum Deflection(mm)
Item	Span Length		1	2	3	
Jamb	1720	+P = 2880	0.2	0.3	0.2	0.1
		0	<0.1	0.1	<0.1	0.1
		-P = -2880	0.3	0.7	0.4	0.4
		0	0.1	0.2	0.1	0.1
Member (mm)		Test Pressure (Pa)	Deflection (mm)			Maximum Deflection(mm)
Item	Span Length		4	5	6	
Glazing	1680	+P = 2880	3.0	10.0	3.2	6.9
		0	<0.1	0.2	0.1	0.1
		-P = -2880	3.6	10.4	3.6	6.8
		0	0.3	0.1	0.4	<0.1

Table B.3 Test Data of Uniform Load Deflection Test for Jamb

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Maximum Deflection		Maximum Deflection	
2880 Pa (60.15 psf)	0.1	(<0.01)	0.4	(0.02)
Span length, L = 1720 mm (67.72 in.) Deflection limit L/175 = 9.8 mm (0.39 in.)				

Table B.4 Test Data of Uniform Load Deflection Test for Glazing

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Maximum Deflection		Maximum Deflection	
2880 Pa (60.15 psf)	6.9	(0.27)	6.8	(0.27)
Span length, L = 1680 mm (66.14 in.) No Deflection limit.				

The tested specimen met the requirements for Class CW-PG60 for Uniform Load deflection Test at Design Pressure as per AAMA/WDMA/CSA 101/I.S.2/A440-17.

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Appendix B: Test Data

B.4 Uniform Load Structural Test – Test method ASTM E330/E330M-2014(R2021), Procedure A

Design Pressure, P = 2880 Pa (60.15 psf)

Structural Pressure, P = 4320 Pa (90.23 psf)

Table B.5 Test Data of Uniform Load Structural Test

Member (mm)		Test Pressure (Pa)	Permanent deformation(mm)			Maximum permanent deformation(mm)
Item	Span Length		1	2	3	
Jamb	1720	+P = 4320	–	–	–	–
		0	<0.1	<0.1	0.1	<0.1
		-P = -4320	–	–	–	–
		0	0.1	0.1	<0.1	0.1
Permanent Deformation limit, L x 0.3% = 5.2 mm						
Member (mm)		Test Pressure (Pa)	Permanent deformation(mm)			Maximum permanent deformation(mm)
Item	Span Length		4	5	6	
Glazing	1680	+P = 4320	–	–	–	–
		0	0.2	0.1	0.4	<0.1
		-P = -4320	–	–	–	–
		0	0.5	0.2	0.4	<0.1
No Permanent Deformation limit.						

Table B.6 Test Data of Uniform Load Structural Test For Jamb

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Perm. Set		Perm. Set	
4320 Pa (90.23 psf)	<0.1	(<0.01)	0.1	(<0.01)

Table B.7 Test Data of Uniform Load Structural Test For Glazing

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Perm. Set		Perm. Set	
4320 Pa (90.23 psf)	<0.1	(<0.01)	<0.1	(<0.01)

After the test loads were released, there was no failure or permanent deformation of any part of the window system that would cause the test specimen to be inoperable. There was no permanent deformation which was in excess of 0.3% of its span.

The tested specimen met the requirements for Class CW-PG60 for Uniform Load Structure Test at Structural Pressure as per AAMA/WDMA/CSA 101/I.S.2/A440-17.

Test Report

Original Issue Date: 2024-08-14

Intertek Report No. 240701007SHF-001

Appendix C: Sample Received Photo



Revision:

NO.	Date	Changes
240701007SHF-001	2024-08-14	First issue